

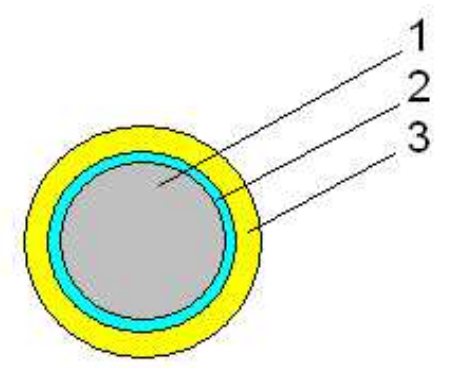
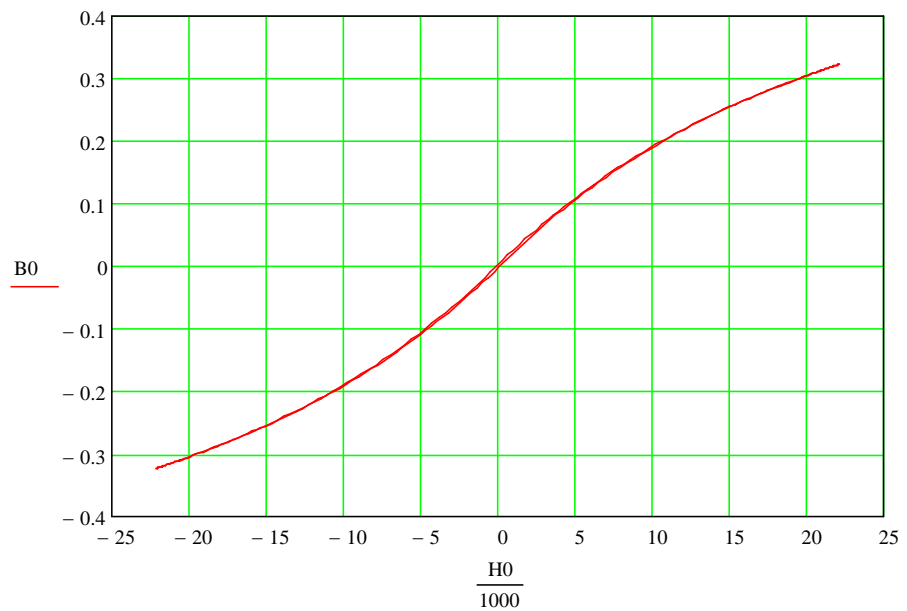


« (1) – 40 – 90 (2) 50 (3), 0,1 – 0,5 5 (μ=50 000, 160 ) 500-550 ° ~ 4,5 / ³). 20 / ²; – 1 – 1 – 150 / ²; 500 ° .

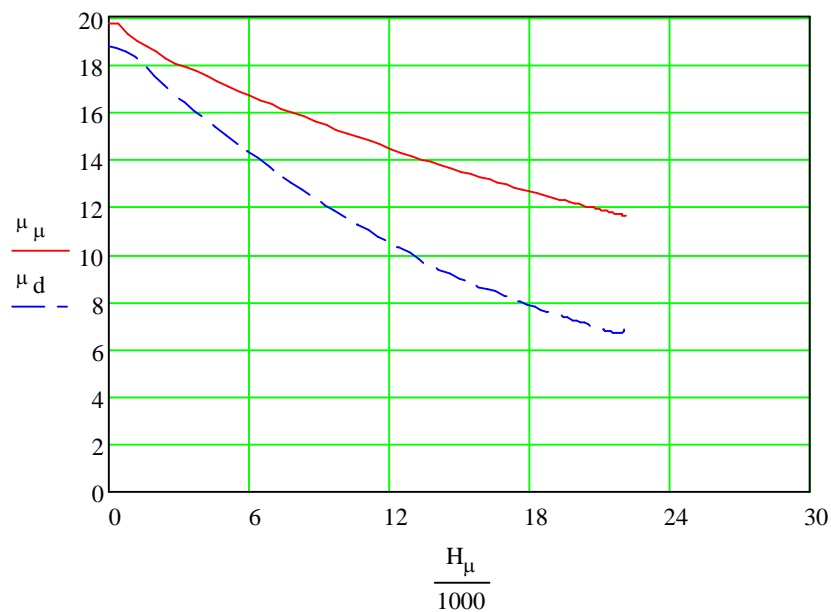

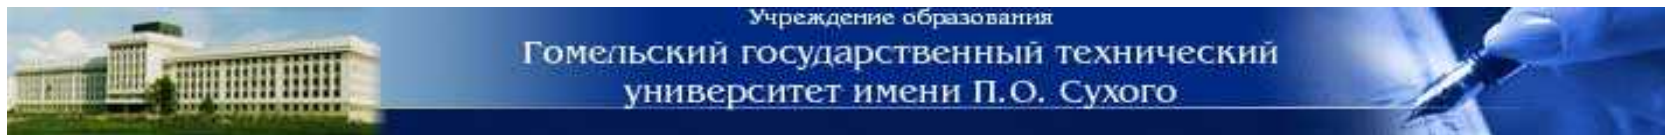

**: +375 232 29 59 34. E-mail: boiko@gstu.by; rossol@gstu.by**